

Capping seal to wall finish. Smooth dry substrate / compatible primer and adhesive. No hollow corner.


Continuous formed cove on proprietary support; nominal 25 mm radius / 100 mm upstand, confirm finish standard.

F01A / F01B 2 mm healthcare sheet vinyl. Hot-weld seams with compatible colour welding rod.

Keep seams away from wet corners. Substrate moisture, flatness and adhesive system to selected vinyl manufacturer.

1 / HEALTHCARE VINYL / FORMED COVE

SCALE 1 : 5

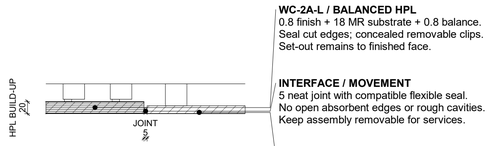


WC-2A-L / BALANCED HPL
0.8 finish + 18 MR substrate + 0.8 balance.
Seal cut edges; concealed removable clips.
Set-out remains to finished face.

INTERFACE / MOVEMENT
5 neat joint with compatible flexible seal.
No open absorbent edges or rough cavities.
Keep assembly removable for services.

HC-01 / WALL FINISH
Wallcovering to prepared smooth substrate.
Adjust grounds for equal finished plane.
Actual finish thickness to approved product.

2 / HPL / WALLCOVERING FLUSH JUNCTION

SCALE 1 : 5



F01A/F01B 2 mm vinyl; raise screed / leveling layer to match top FFL. No trip or beveled ramp.


F06 20 mm natural marble. Compatible white full-bed adhesive; stone sealed to selected supplier requirement.

Proprietary flush separator at finish change. Align below closed door leaf where applicable; preserve movement joints.

Ground build-up measured: FFL +0.650 / structural slab top +0.500. Adjust screed to selected finishes; do not alter structural slab.

3 / MARBLE / VINYL FLUSH THRESHOLD

SCALE 1 : 5



Stone-compatible flexible sealant over backer rod / bond breaker. Flush neat surface; no three-sided adhesion.

Continue building movement joints through finish and bedding; do not bridge with marble or grout.

Joint width shown 10 mm as DD basis only. Final movement-joint spacing / width to stone system, bay geometry and structural movement. Perimeter gaps concealed at walls / joinery.

4 / STONE MOVEMENT JOINT

SCALE 1 : 5

P1 / PORCELAIN TO VINYL - FLUSH FFL



10 mm porcelain / compatible adhesive. Retain actual +5.450 FFL; adjust screed to approved product thickness.

2 mm healthcare vinyl over smoothing compound. Flush proprietary divider; no raised lip.

Screed build-up indicative: confirm structural substrate and adhesive allowance on site. No structural slab cutting.

P2 / PORCELAIN PERIMETER - FLEXIBLE SEALED JOINT



10 mm isolation joint at wall / column. Backer rod and compatible neutral-cure sealant; continue all structural joints.

F02A / 1200 x 1200 x 10 mm marble-look porcelain. Wall finish and skirting per room finish schedule.

5 / PORCELAIN / VINYL AND PERIMETER - WAITING

SCALE 1 : 10

CLIENT:

Bupa CareConnect

ENGINEERING CONSULTANTS:

AJi

MEDICAL & ID CONSULTANTS:


hdp

SUB CONSULTANT:

DRAWING NOTES:

LEGEND:

KEYPLAN:

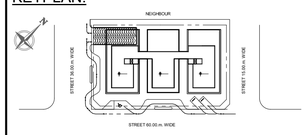

Issued For Review

THIS DRAWING IS THE COPYRIGHT OF ARABTECH JARDANEH INTERNATIONAL AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE CONSULTANT'S AUTHORIZATION

Rev.	Description	APPD BY.	DATE (DD.MM.YYYY)
D00	DETAILED DESIGN STAGE		22-11-2026

DRAWN BY:	MR	DESIGNED BY:	HA
CHECKED BY:	NA	APPROVED BY:	NA
QC REVIEW BY:	NA	DWG ISSUE DATE:	22/11/2026

PROJECT:

ICC2 CLINIC PROJECT-BUPA

Plot No.:	11/1646
Basin NO. & Name :	1578/B Riyadh
CONCEPT DESIGN STAGE	SCHEMATIC DESIGN STAGE
DETAILED DESIGN STAGE	ISSUED FOR TENDER

DRAWING TITLE:

FINISHES - COVED SKIRT AND WALL JUNCTIONS

DWG NO. SA369 - AJi - ZZ - ID - ID503

SCALE @ (A1)	SHEET SEQUENCING	SUITABILITY CODE	REVISION
SHOWN	01 OF 01	A3	D00